






REVISIONS				
ZONE	REV	DESCRIPTION	DATE	APPROVED
	0	Initial Drawing	12/20/2005	Ed Brown

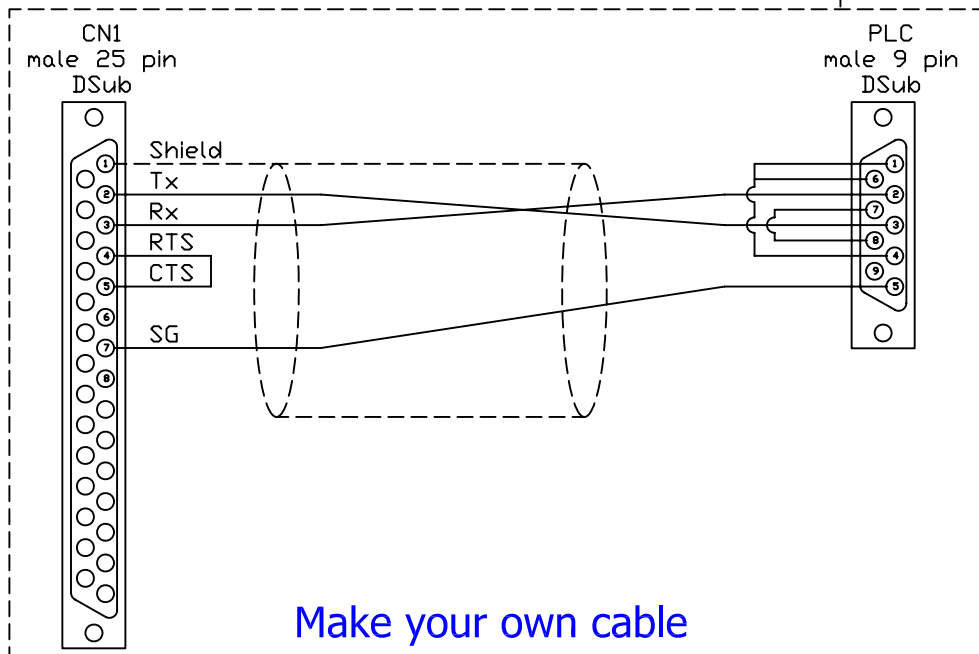

Note:
This connection uses the AB programming cable because the mini-DIN connection on the PLC is non-standard.

Monitouch to Micrologix

Serial cable connection for CN1

		SIZE	FSCM NO.	DWG NO. CBL-ABML-CN1	REV
		SCALE	None	SHEET	1 of 1